



Designing Hybrid Systems to Optimize Resilience

February 2024

Changing the World's Energy Future

Megan Jordan Culler



DISCLAIMER

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness, of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trade mark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

Designing Hybrid Systems to Optimize Resilience

Megan Jordan Culler

February 2024


**Idaho National Laboratory
Idaho Falls, Idaho 83415**

<http://www.inl.gov>

**Prepared for the
U.S. Department of Energy
Under DOE Idaho Operations Office
Contract DE-AC07-05ID14517**

Megan Culler
Power Engineer & Researcher
Idaho National Laboratory

February 27, 2024

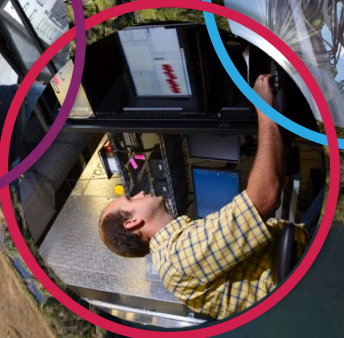

Designing Hybrid Systems to Optimize Resilience

INL/CON-24-76797



On Site Wind for Rural Load Centers

Applications for hybrid systems

- Case studies
- Opportunities





Justifying the cost of hybrid systems

- Valuation framework




Using renewable resources to enhance resilience

- Resilience framework




Tools to design hybrid systems

- Resilience application
- Hybrid Optimization and Performance Platform (HOPP)




Funding opportunities

- Opportunities and technical assistance





Residential



Industrial



Commercial




Agricultural

Funded by the Wind Energy Technologies Office




Distributed Wind Hybrid Toolkit

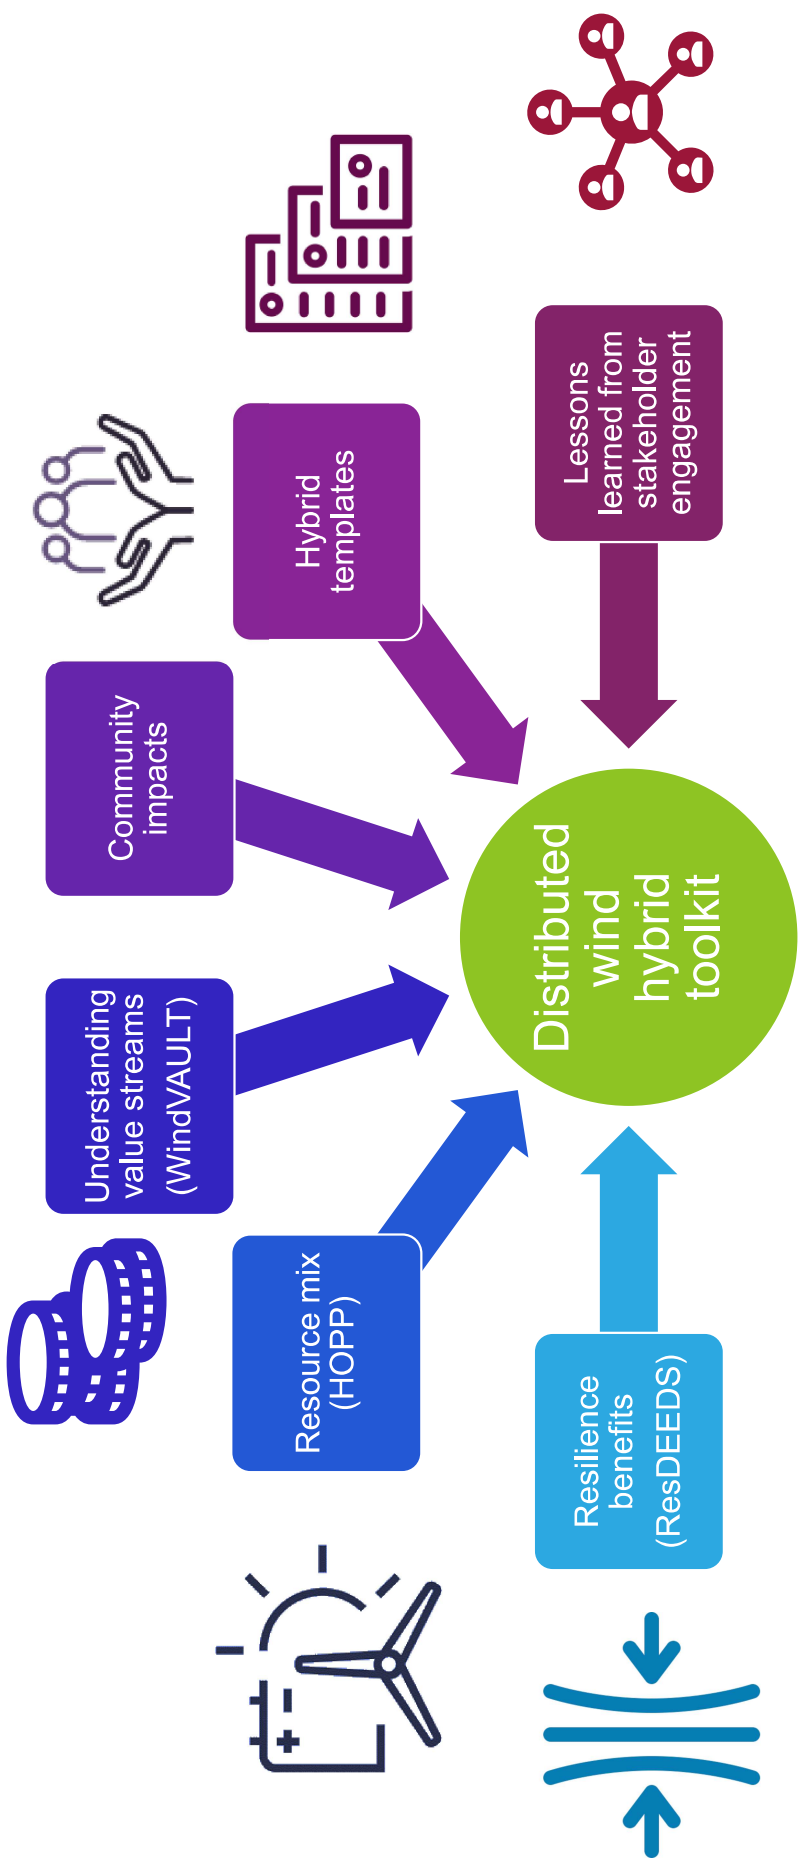

LREC Example: Hybrid generation mixes



- Original system:
 - Wind: 2.0 MW
 - PV: 500.0 kW
 - Interconnection: 2.0 MW
 - Hybrid Capacity Factor: 32.4 %
 - Percentage of total demand: 1.8%

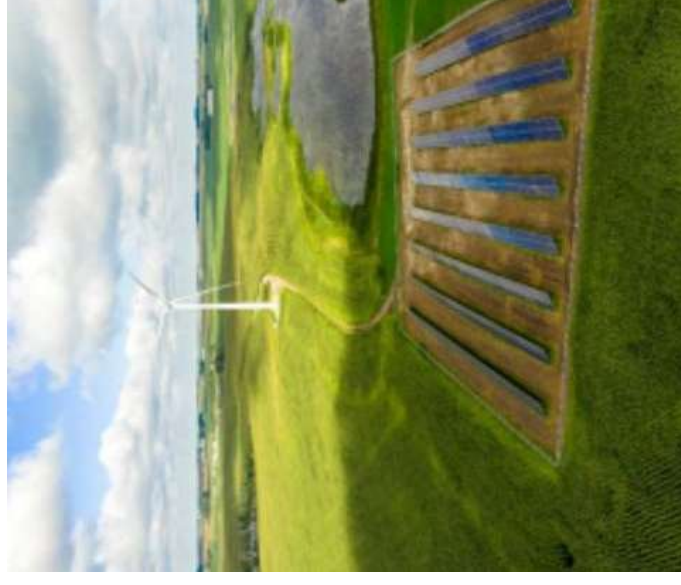

<https://www.cooperative.com/programs-services/bts/radwind/Documents/RADWIND-Case-Study-Lake-Region-May-2021.pdf>

LREC Example: Savings analysis for different configurations and feeders – without storage

Case summary	Case description
1	Balanced 11.5 MW wind, 3.0 MW solar, 0 MWh battery
2	Balanced 11.5 MW wind, 3.0 MW solar, 0 MWh battery
3	Wind only 13.8 MW wind, 3.0 MW solar, 0 MWh battery
4	Cost Prioritized 4.6 MW wind, 1.0 MW solar, 0 MWh battery
5	PV only 0 MW wind, 25 MW solar, 0 MWh battery

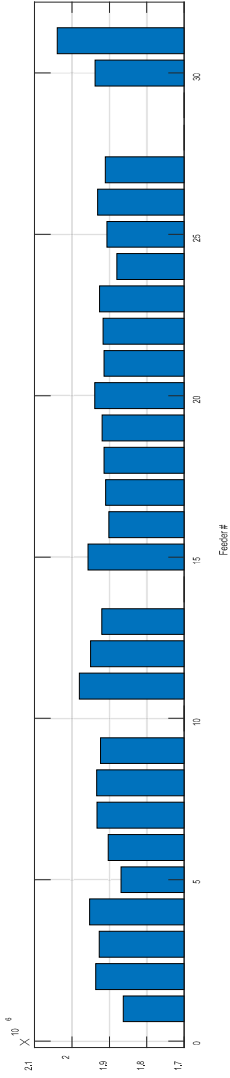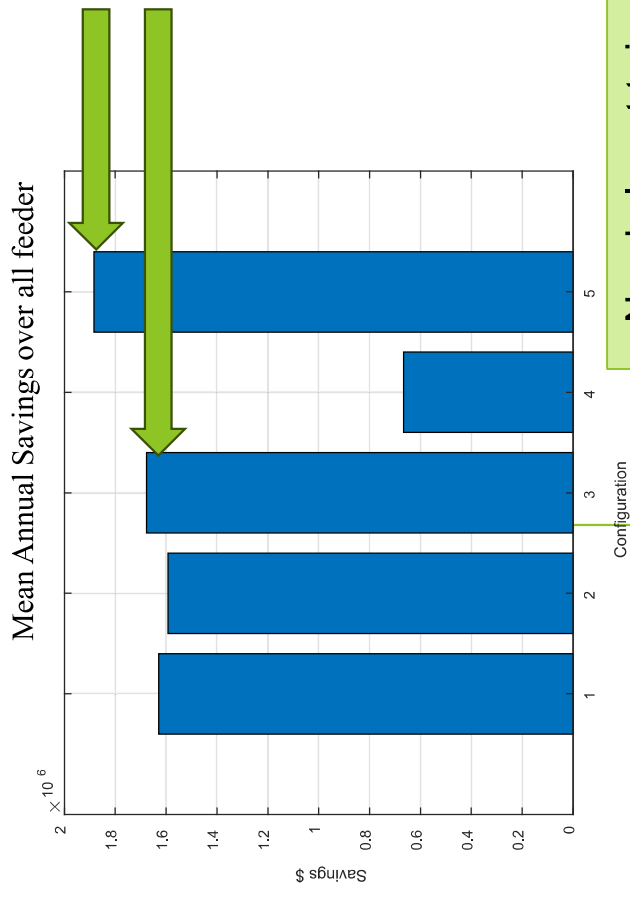





Need almost twice the total system capacity to get the same savings

Resilience through hybrid power systems

- Suit the needs of my community.
- Balance cost AND benefits.
- Economically viable and operationally practical.
- Create a level of self-sustenance.
- Drive system development by local interests.
 - Know the historic events
 - Know the customer needs and flexibilities
 - Know the neighboring communities and mutual aid networks
 - Know the system strengths and weaknesses



Think about the needs, resources, and social capital of your community.

Load Profiles Analysis

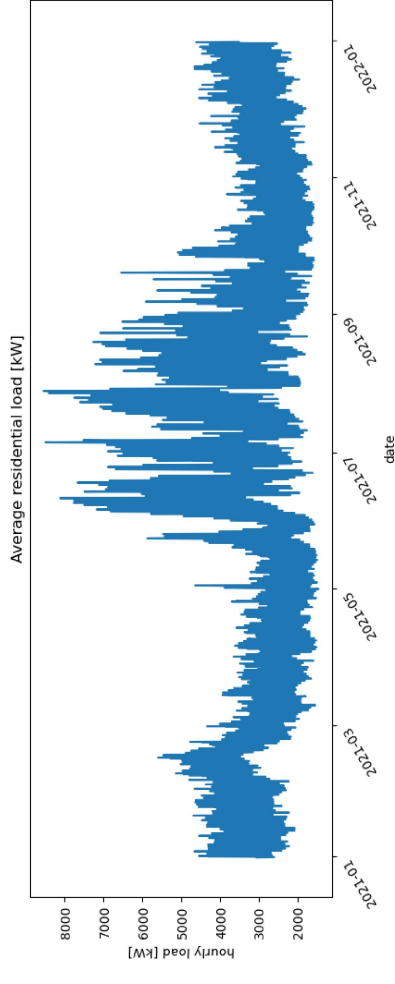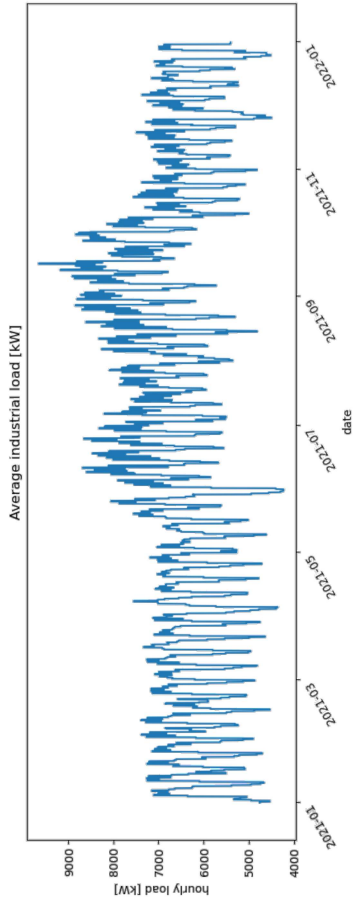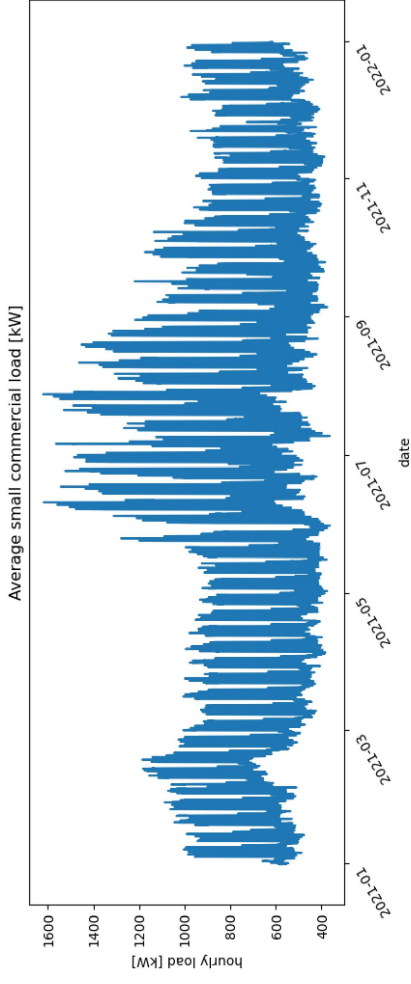
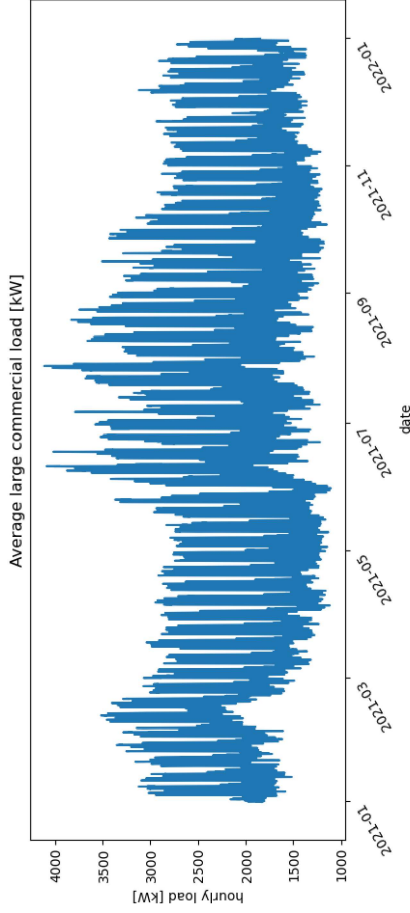


Healthcare facilities (same town)

Variance in bed count, heating/cooling method, building efficiency, and type of services.


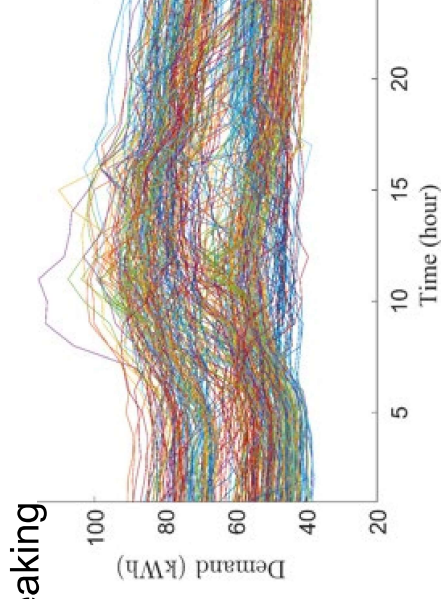
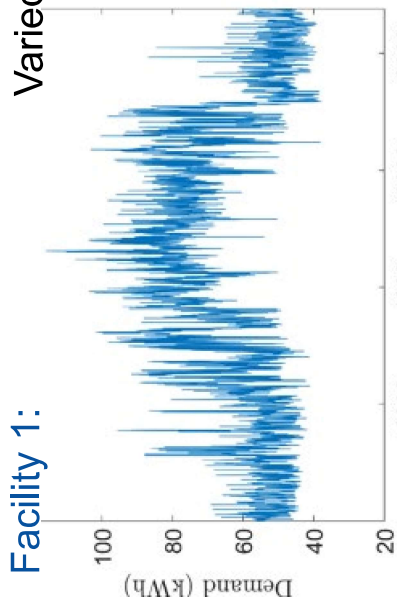


More random peaking, but relatively constant window.
Notice gap in mid-range power.

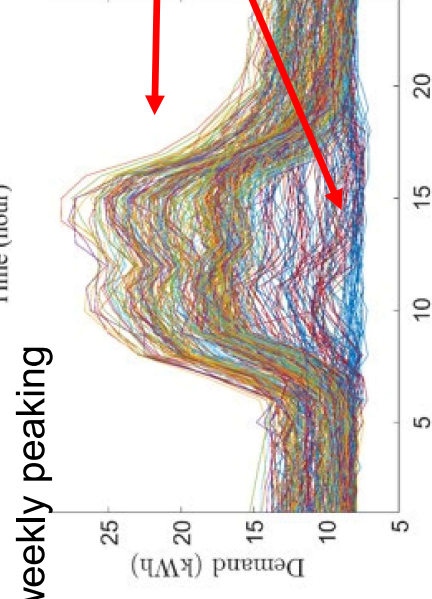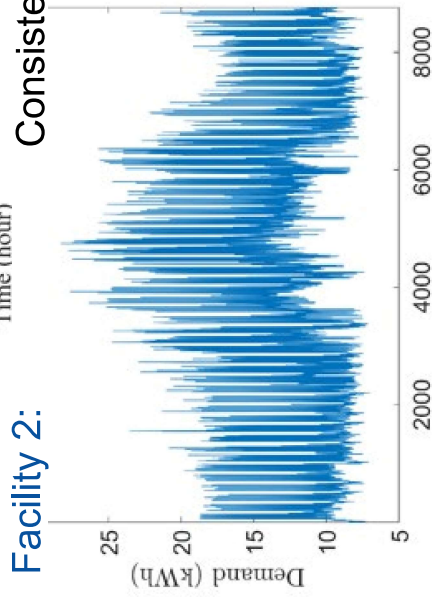


High relative daily peaks,
But not all days have peaking.

Living-care facility (same town)

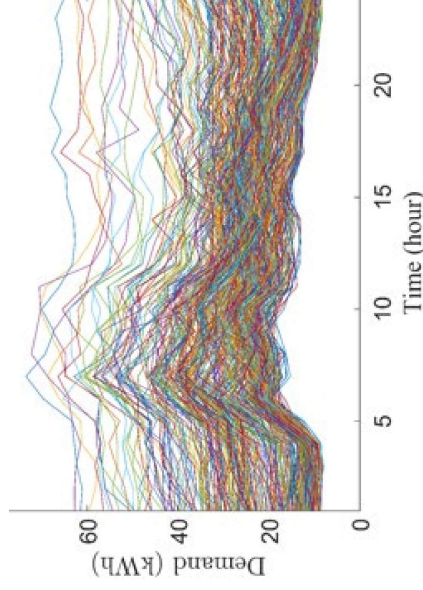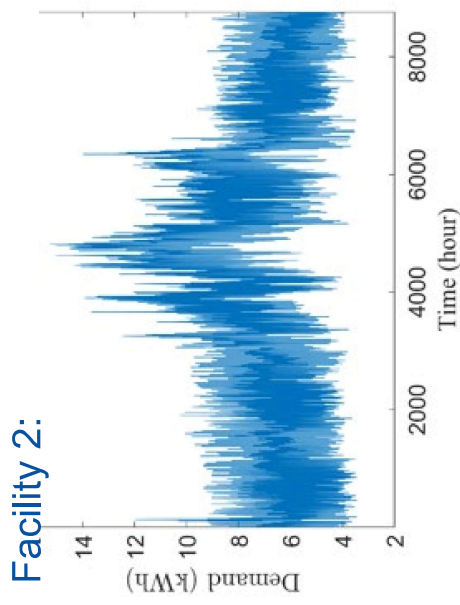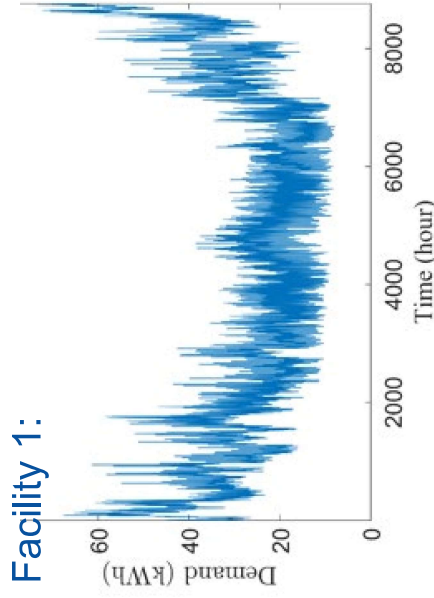

Larger seasonal winter demand

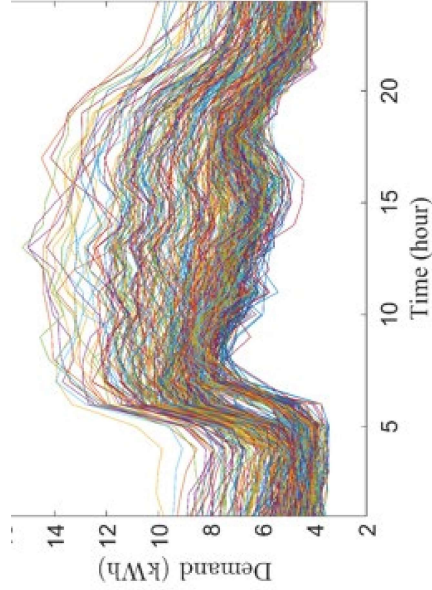

Larger seasonal summer demand

Community interests

Communities have varied & unique interests.
Resilience is created by serving all of those.

- What is fiscally feasible?
- What is politically easy?
- What is technically achievable?
- Ownership benefits are rate dependent.
 - Commercial owners?
 - Residential owners?
 - Utility owners?
- Beyond conventional use
 - disaster response plans for critical loads

It is important to have a mix of resources. Each type has a role.

The amount of generation needed to match load is finite and may have numerous contributors.

Each rate class may experience benefit differently – What ownership model brings the most community benefit?
Use the natural resource as it is available. Cache energy in storage mechanisms to fill gaps in natural resource.

Business operations

Hybrids can provide cost-effective process solutions.

Local energy storage can avoid critical shutdowns.

Modular and mobile units for remote interim power.

- Habits may change to match available resources.
 - Machines paired with a rich natural resource.
 - Processes located to capture onsite energy.
- Markets may shift with evolution of energy systems.
 - Forecasting is as important as historical views.

SunCrate Mobile Microgrid powering BES Water Solutions' wastewater treatment



Battery served 50-60% of the time.

If use propane alone (2 gal/hr, \$2/gal): \$21,792 for 8 months.

Actual generator fuel cost: \$3,904 (976 hours of runtime)

Fuel-cost savings by adding PV+Battery: \$17,888.

Onboard propane used for setup, extreme cold, and night operation.

The addition of wind power would further reduce fuel usage.

Constant pumping and aeration to stimulate biologic activity; 3-5 kW.
Improve rural water quality.

Serve load and be available for relocation with 10-hour+ at 7.5 kW.

Led to second design:
PowerPallet –

Battery+converters, 12 kW, 90 kWh




Suncrate Mobile Microgrid powering BES Wastewater treatment plant

Consumed Solar kWh Total Solar kWh Generated Total kWh Consumed

150


Long summer days are mostly self-powered.
 Low angle in winter reduces PV power.
 Desire wind power for winter and spring.

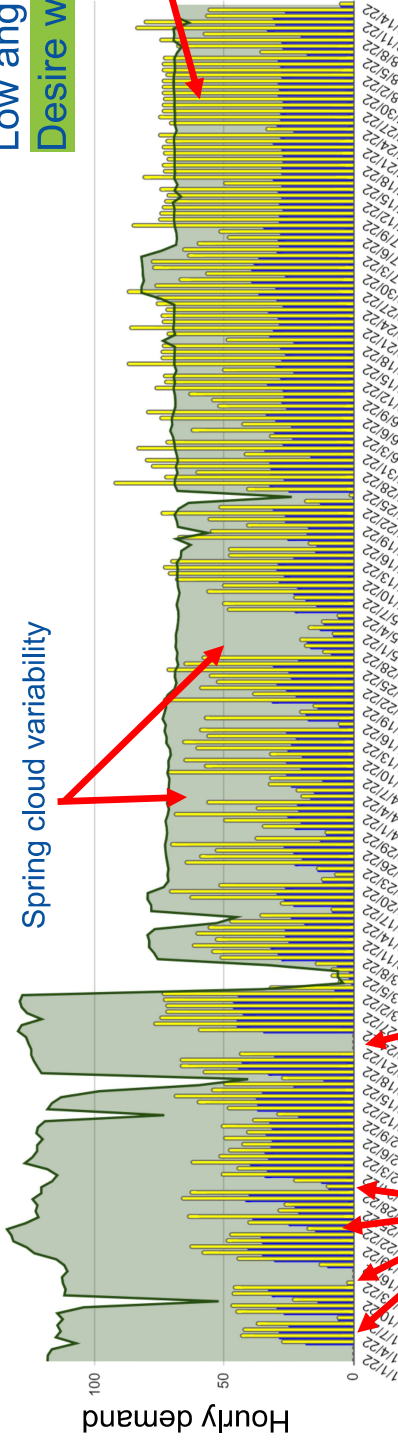

Use of battery is relatively constant throughout duration.

Generator is used more in winter and during cloudy spring days.

Daily load and battery usage

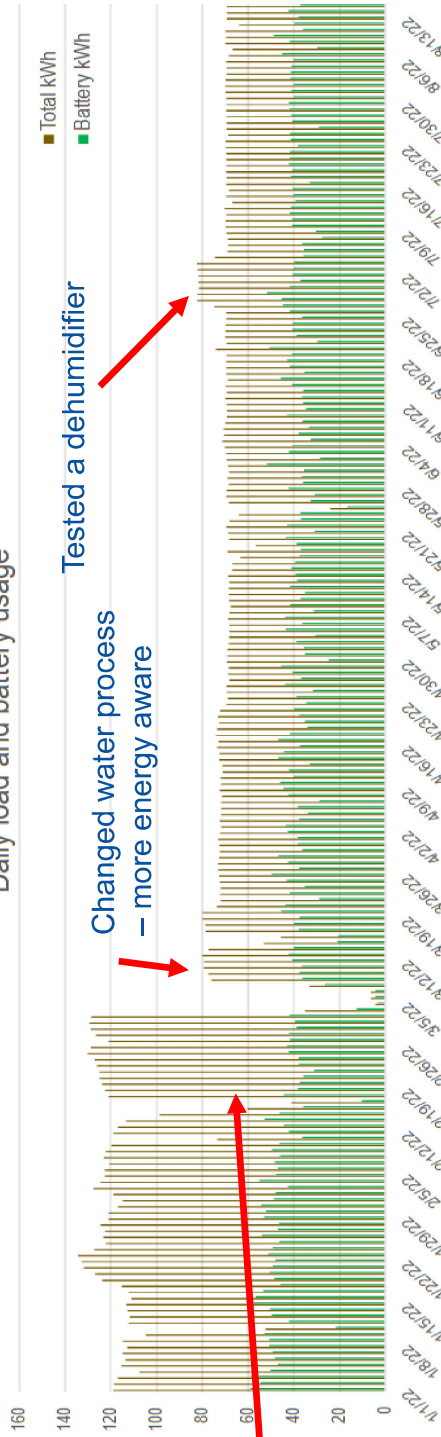


Conditions and limitations

Match the resource and the load with goals of the locality and constraints of the region.

- What drives the load/generation profiles and development constraints?
 - Environment suitability – fires/floods, land cost/use (e.g. ag, housing), right-of-ways
 - Community values, social and economic activity
 - Infrastructure (power lines, pipelines, roads, rails, ports...)

- What drives how resource and load are paired?
 - Location of load center, and surrounding landscape
 - Space, surface area, height, setbacks
 - Distribution network
 - Costs of repowering machines or facilities

- What are the resilience needs of the community
 - Critical loads
 - Understand emergency response plan

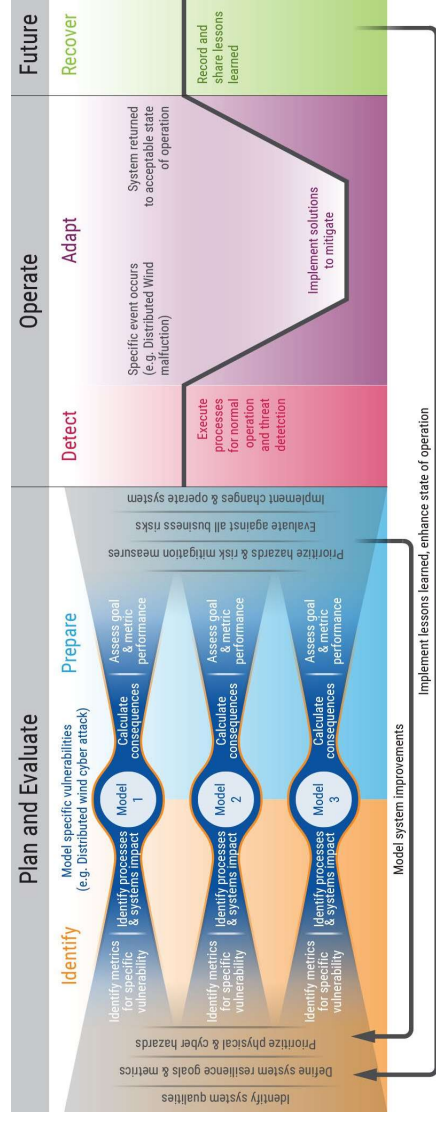

Resilience Framework for Electric Energy Delivery Systems



Idaho National Laboratory

Battelle Energy Alliance manages INL for the U.S. Department of Energy's Office of Nuclear Energy. INL is the nation's center for nuclear energy research and development, and also performs research in each of DOE's strategic goal areas: energy, national security, science and the environment.

WWW.INL.GOV